
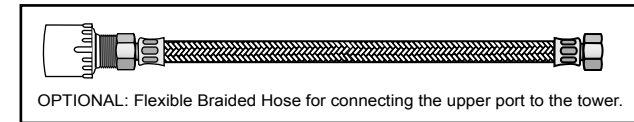
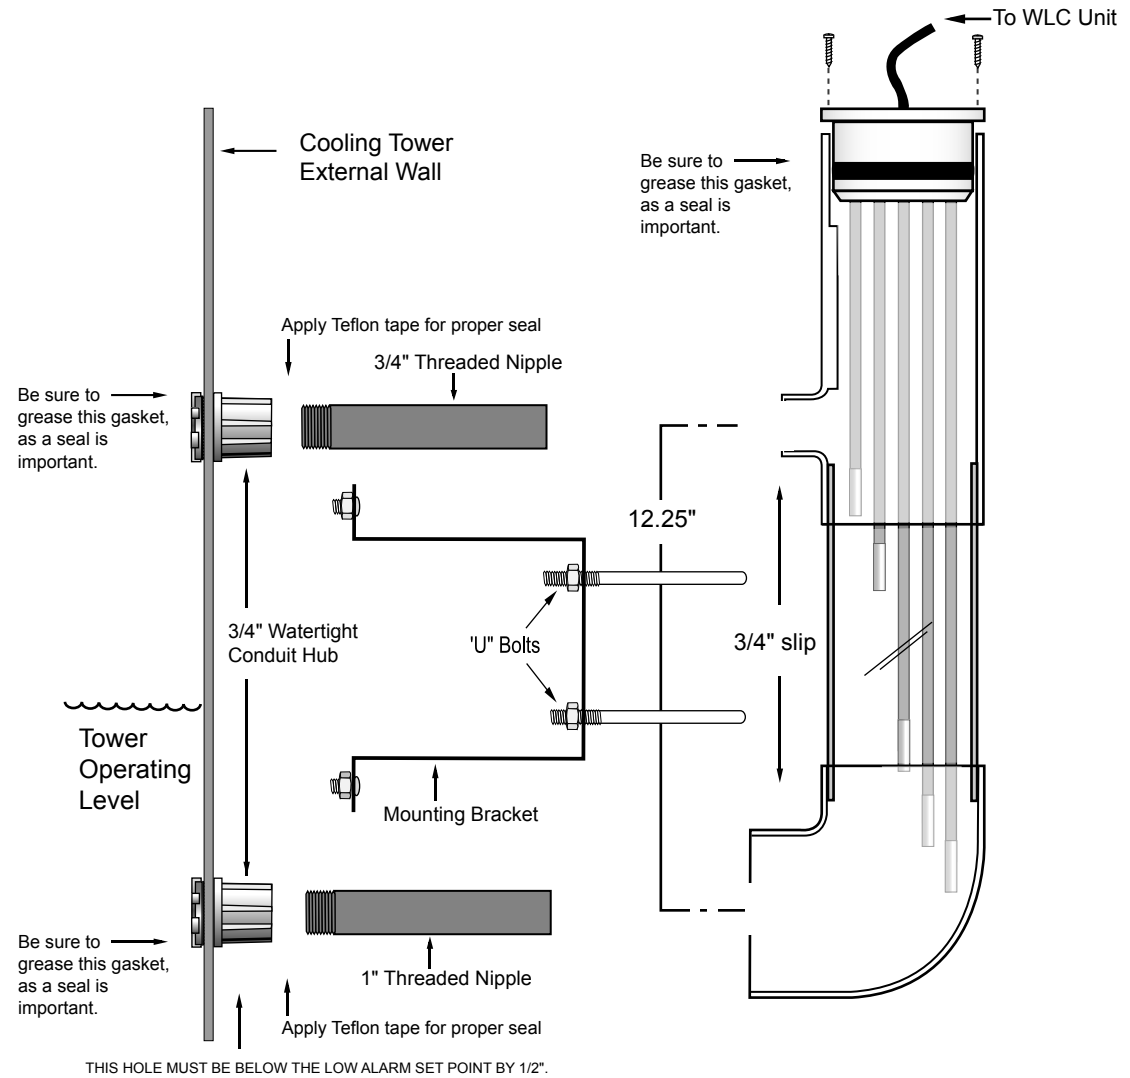


# External Static Pipe

<b>A</b>	<b>B</b>	<b>C</b>	<b>D</b>	<b>E</b>
<b>F</b>	<b>G</b>	<b>H</b>	<b>I</b>	<b>J</b>

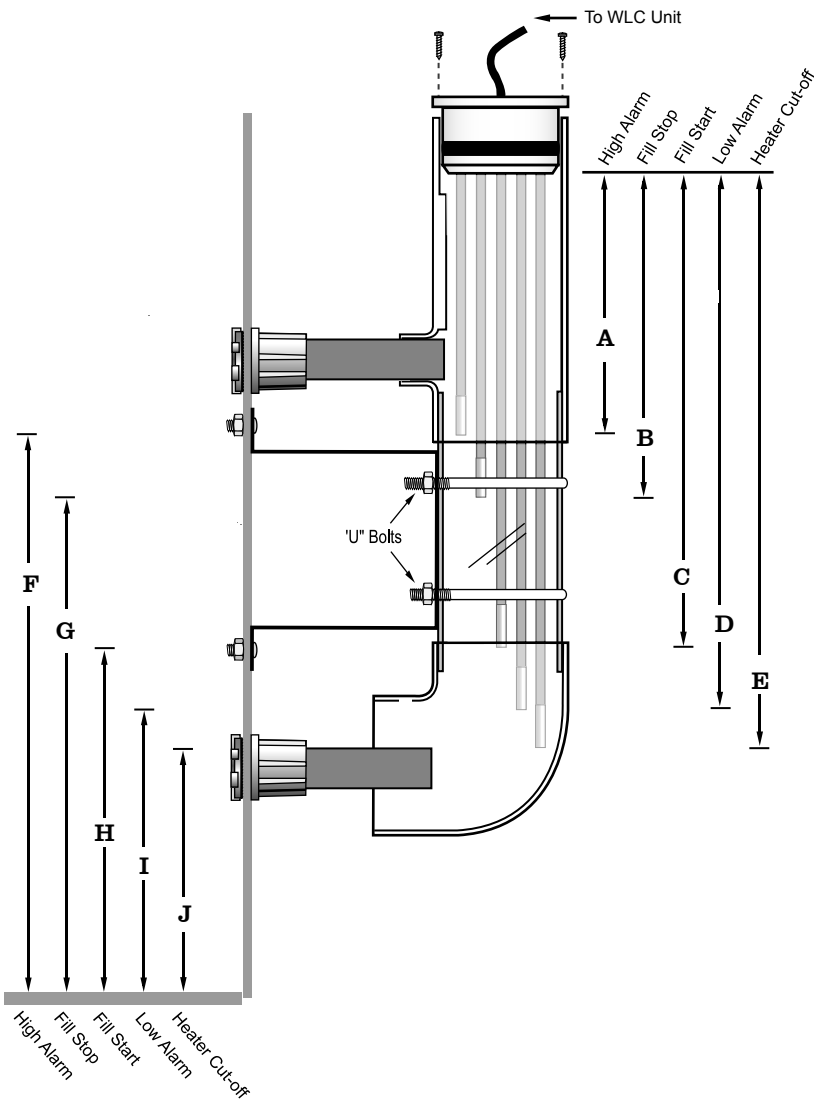

1. Locate holes (12.25 ") center to center in the Tower Wall.
2. Put water tight Hub in the holes.
3. Thread 1" PVC nipples in the Hubs.
4. Put glue on both nipples and glue in the chamber.

<b>Part Numbers for External Pipe</b>		
• EXSTD-330	• EXSTD-345	• EXSTD-360
• EXSTD-340	• EXSTD-350	• BR-2

<b>Waterline Controls</b>	
P.O. Box 12544 Scottsdale, Arizona 85260	
Toll Free: 888-905-1892 Fax: 480-629-8223	
TITLE: External Static Pipe	
WATERLINE CONTROLS	DWN BY <i>Pamela Crandall</i> APPVD BY <i>Bill Seneff</i>
SCALE: NTS	DWG NO.
DATE: 11-1-11	<b>EXSTD-01</b>