


SPECIFICATION FOR WLC5000 FILL WITH HIGH LEVEL & LOW LEVEL ALARMS

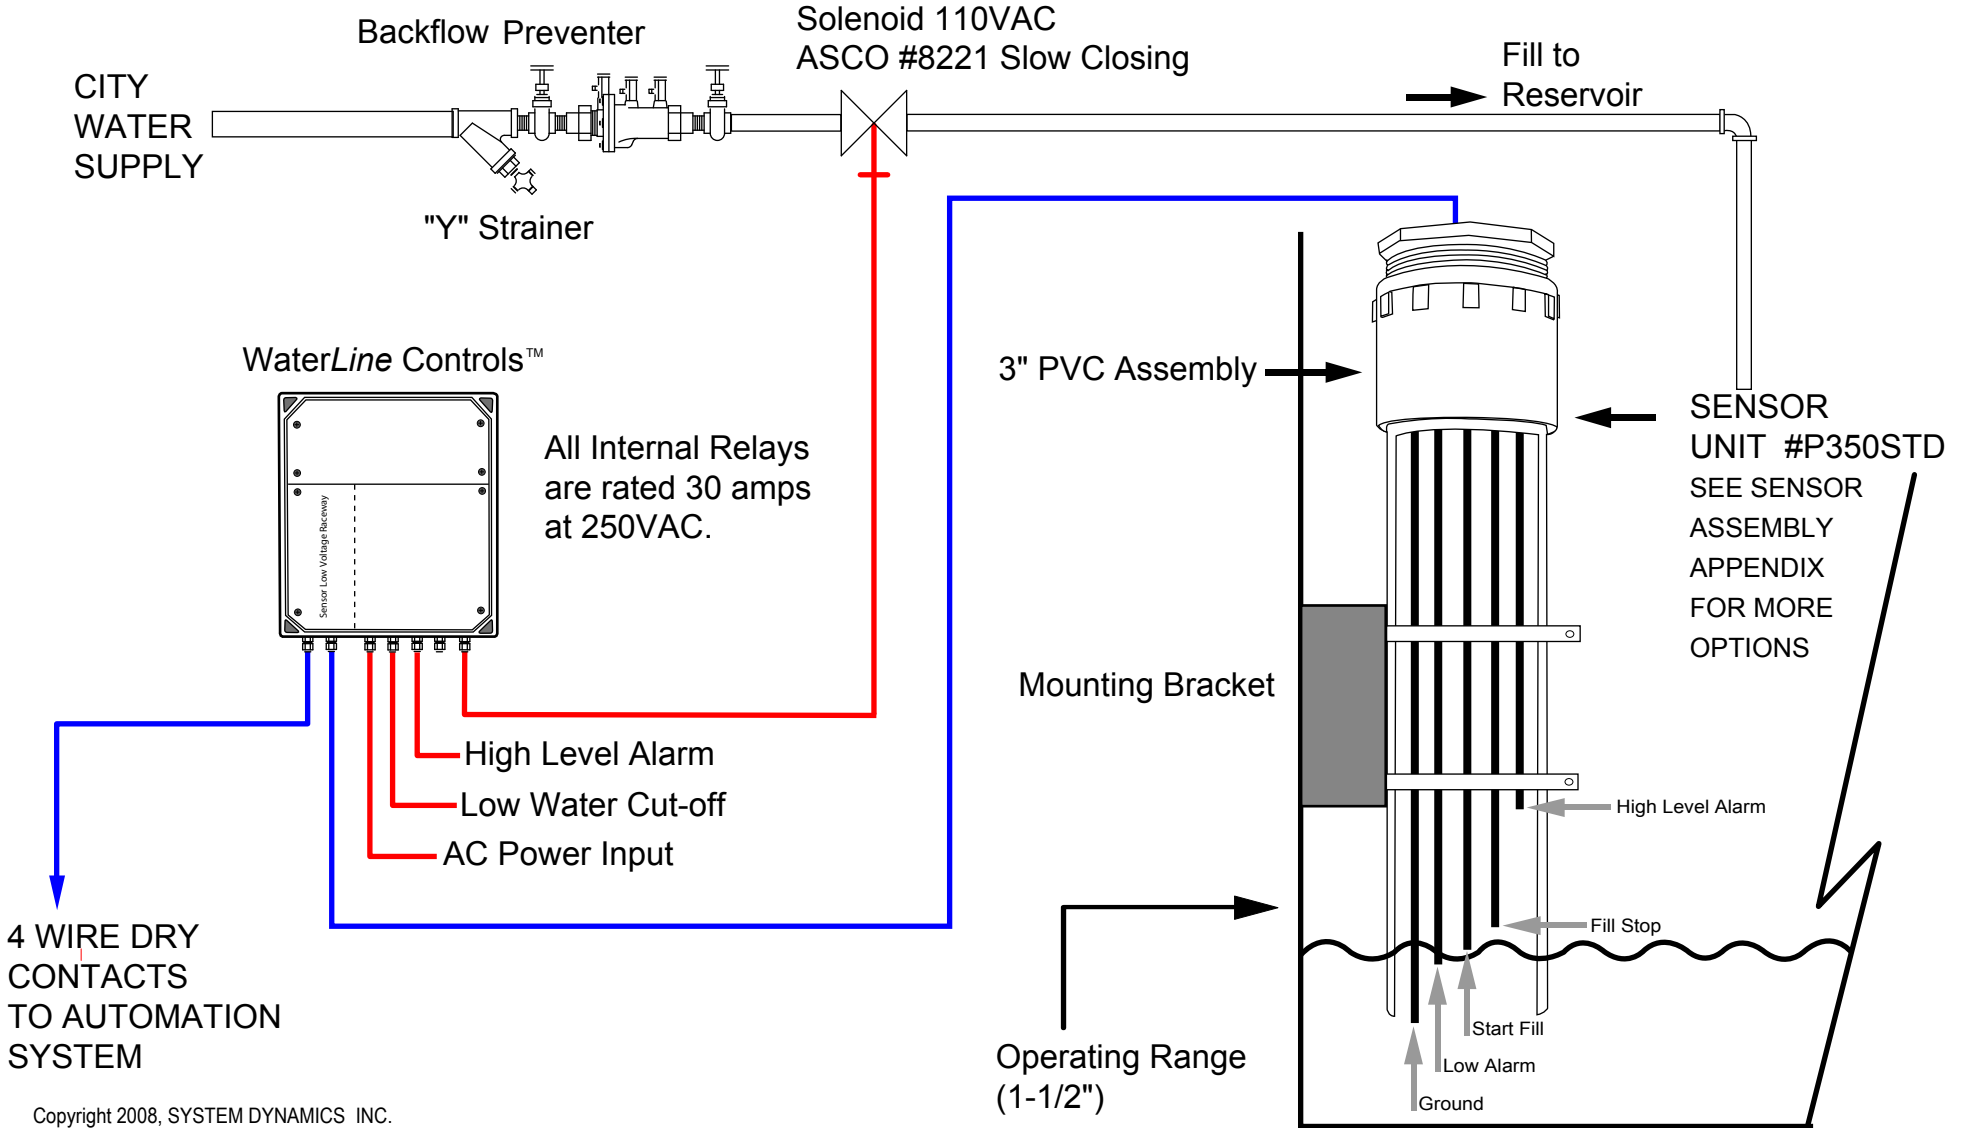

Copyright 2008, SYSTEM DYNAMICS INC.

Blue lines are low voltage Red lines are high voltage		ELECTRONIC LEVEL CONTROL				This document contains information Proprietary and confidential to SYSTEM DYNAMICS INC. It shall not be reproduced, copied or made available to others without prior written consent from SYSTEM DYNAMICS INC.	SYSTEM DYNAMICS, INC. PO Box 12544 Scottsdale, Arizona 85260 1-888-905-1892 www.waterlinecontrols.com		DRAWING NO.	REV.
DATE	REVISION BY	APPROVED:	DWG. REF.:	NOT TO SCALE	S.O. #				SHEET	OF
		CHECKED:	DRAWN:	DATE:	P.O. #					